

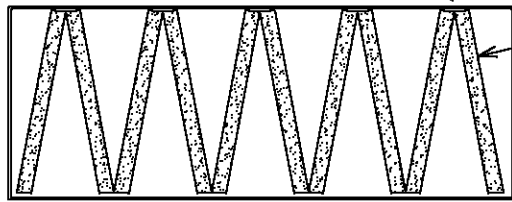


INTERNAL VIEW
SHOWING "V" BANK
PANEL ARRANGEMENT


HOUSING
FRAME

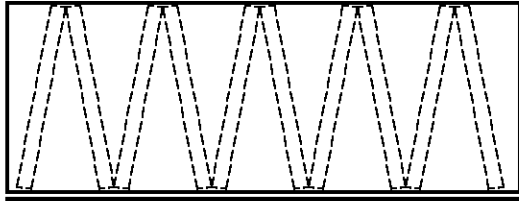


TEN (10) FILTER PANELS,
NOMINAL 1" DEPTH.
26 GAUGE FRAME WITH
26 GA. PERF. SCREENS (.045"
HOLES, 37% OPEN AREA)

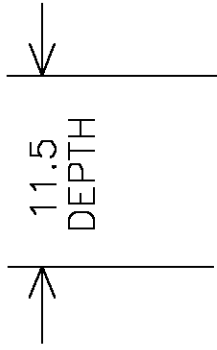

SIDE VIEW

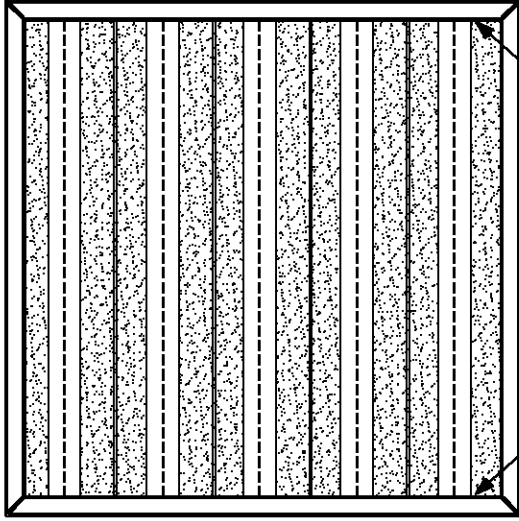

RIGHT END VIEW
FACING AIR OUTLET

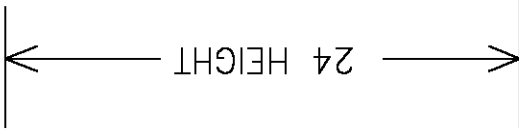

NOTES

1. MATERIAL: 304 SS, 16 GA. FRAME, 20 GA. END CAPS
2. RATED FLOW: 1000 GPM AT 250 FPM FACE VELOCITY
3. PRESSURE DROP AT RATED FLOW: 1.0" W.G.
4. CARBON CAPACITY @ 100% FILL:
STANDARD CARBON @ 30 LB./FT³: 55 LBS.
IMPREGNATED CARBON @ 34 LB./FT³: 60 LBS.
5. EMPTY HOUSING WEIGHT: 62 LBS.
6. JOINTS BETWEEN TRAYS ARE GASKETED, CAULKED,
AND COVERED WITH END CAPS TO PREVENT BYPASS.
7. GASKET ON UPSTREAM FACE OF FILTER:
3/4" X 1/4" CLOSED CELL EDPM MATERIAL
8. TRAY ENDS ARE POTTED (SEALED) TO HOUSING
FRAME TO PREVENT BYPASS.
9. SUITABLE FOR USE IN "BAG IN-BAG OUT" APPLICATIONS.

PROPRIETARY DRAWING
DRAWING MAY NOT BE USED OR REPRODUCED
WITHOUT WRITTEN AUTHORIZATION OF
CAMERON GREAT LAKES, INC.

TOLERANCES: LENGTH +/- 0.125 IN.

REV.	DATE	BY	REMARKS
-	02/01/00	JMB	ORIGINAL ISSUE

DRAWN: JMB
CHECKED: PUL
APPROVED: RAH

TITLE: GENERAL ARRANGEMENT
MODEL ZBH-SS-12 - 304SS
ZERO BYPASS FILTER HOUSING
SCALE: N.T.S. DWG. NO. ZBH-SS-12



CAMERON GREAT LAKES, INC.
2385 NW 29th AVE. PORTLAND, OR 97210
TEL. 800-777-4044 FAX 503-225-0137